


Domestic Water Service Detail - Slab On Grade Structure

No Scale

Note:

1. See Valve and Fitting Installation Details for Additional Requirements.

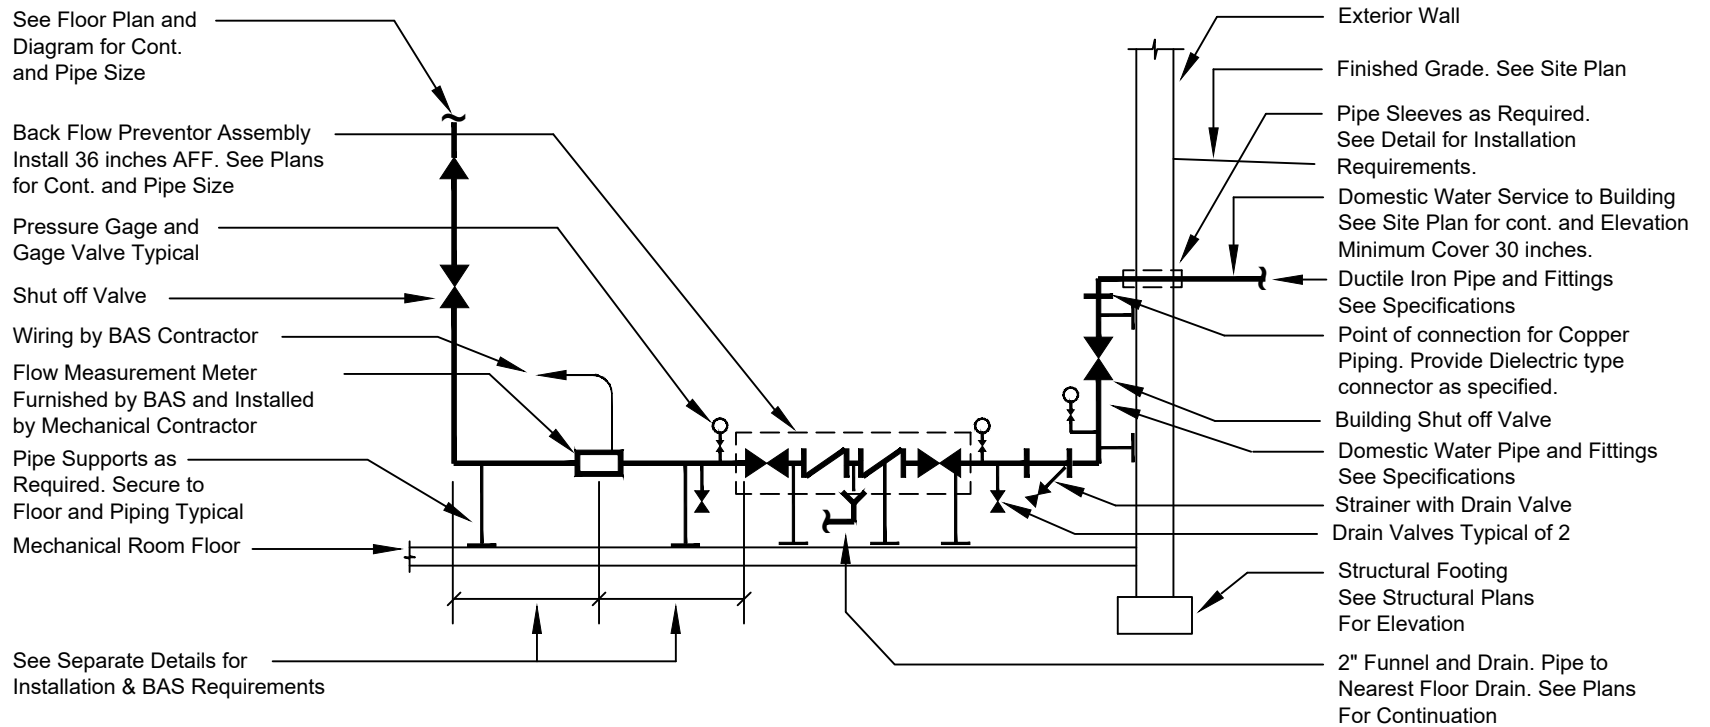


Domestic Water Service Detail - Below Grade

No Scale

Note:

1. See Valve and Fitting Installation Details for Additional Requirements.

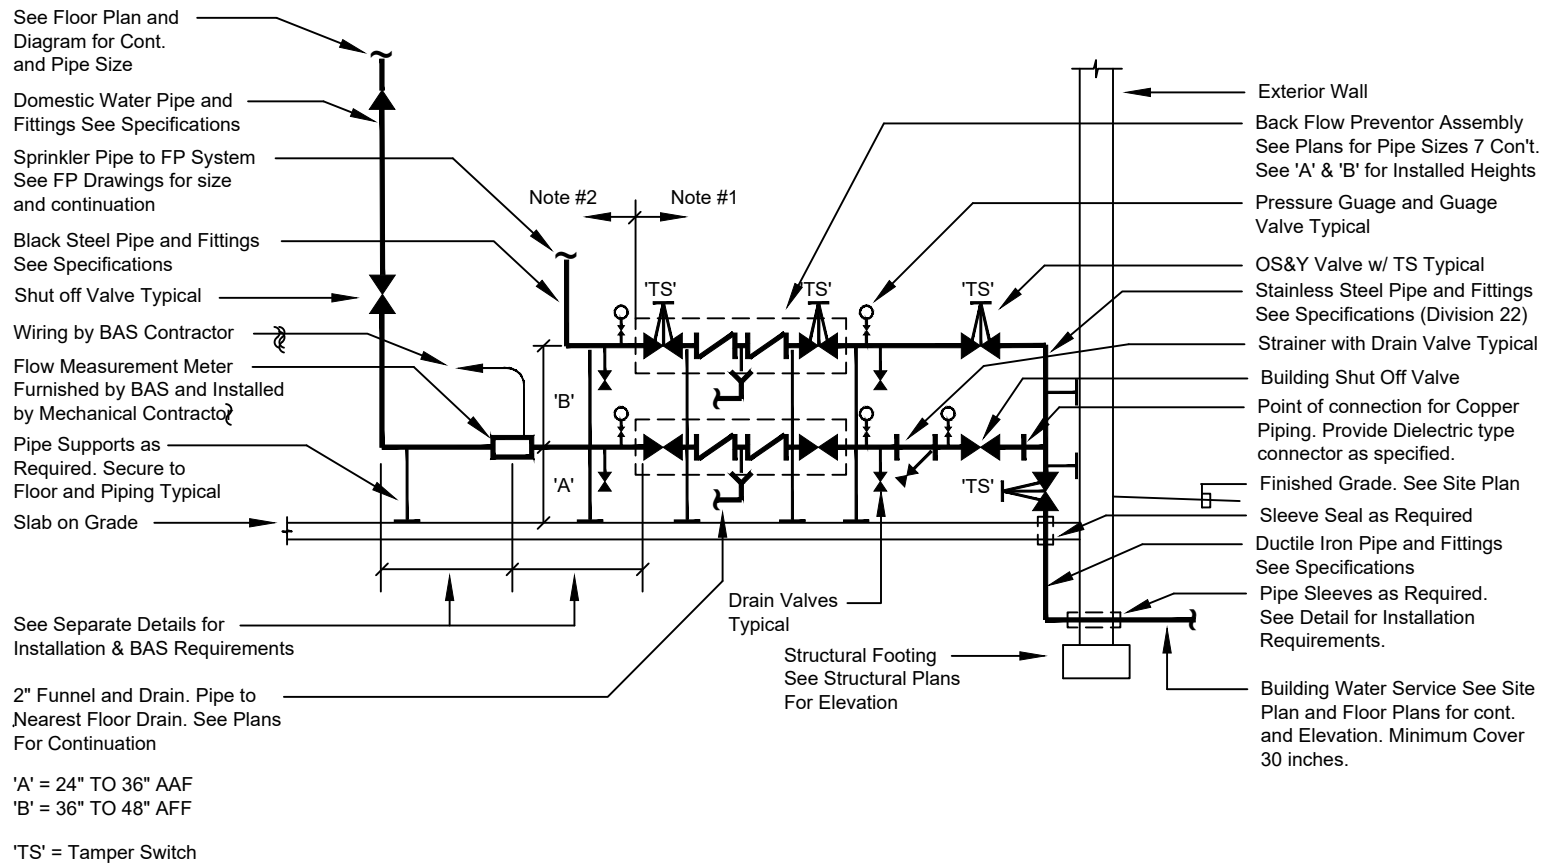


Slab On Grade Structure

Domestic Water & Fire Protection Service Detail

No Scale

Note:

1. Back Flow Preventor, Pipe and Fittings Furnished and Installed by Plumbing Contractor. OS&Y Valves Furnished by Fire Protection Contractor and Installed by Plumbing Contractor. Tamper Switches Furnished and Installed by Fire Protection Contractor.
2. Sprinkler Pipe and Fittings Furnished and Installed by Fire Protection Contractor.
3. See Valve and Fitting Installation Details for Additional Requirements.

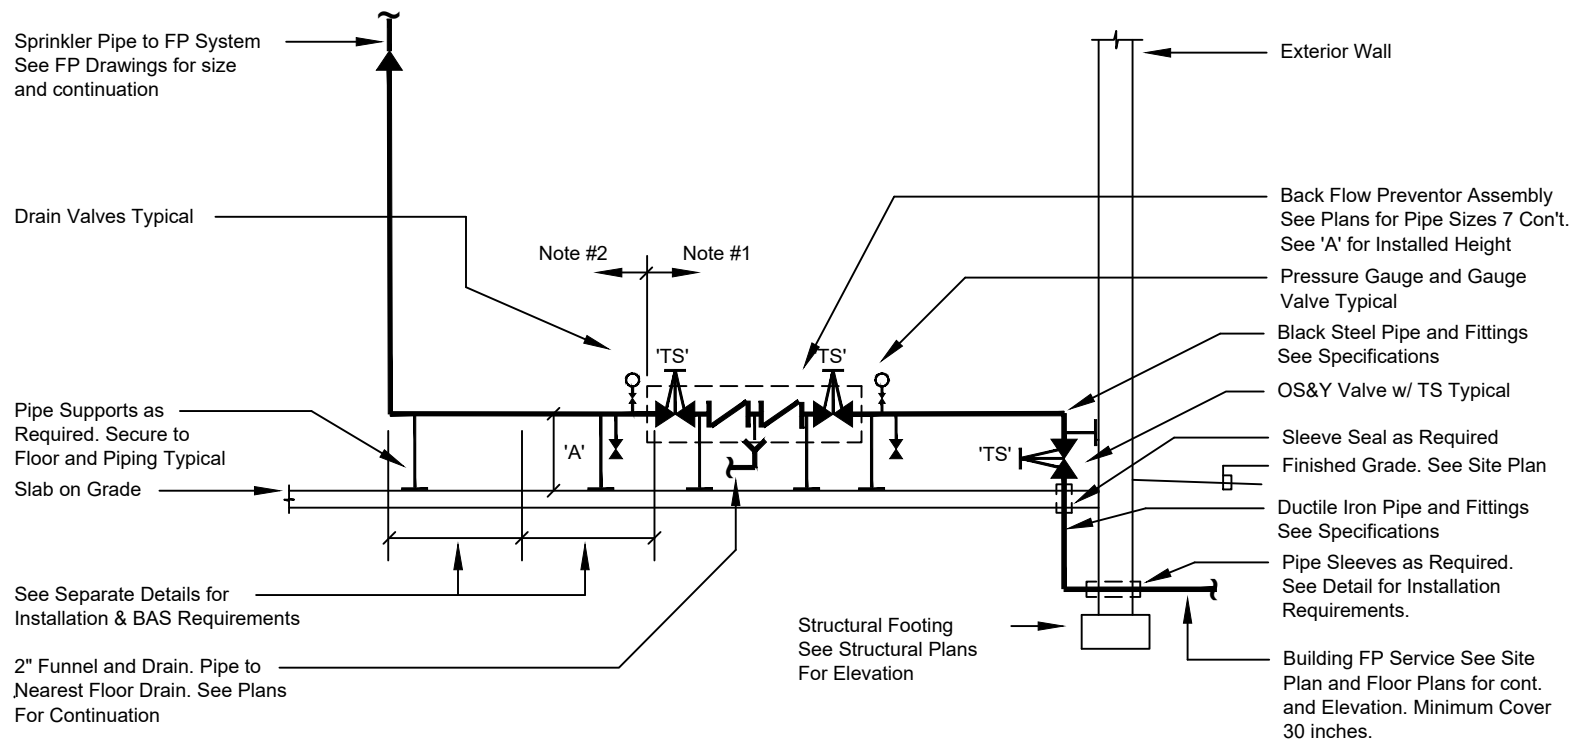

'A' = 24" TO 36" AAF
 'TS' = Tamper Switch


Slab On Grade Structure

Fire Protection Service Detail

No Scale

Note:

1. Back Flow Preventor, Pipe and Fittings Furnished and Installed by Plumbing Contractor. OS&Y Valves Furnished by Fire Protection Contractor and Installed by Plumbing Contractor. Tamper Switches Furnished and Installed by Fire Protection Contractor.
2. Sprinkler Pipe and Fittings Furnished and Installed by Fire Protection Contractor.
3. See Valve and Fitting Installation Details for Additional Requirements.

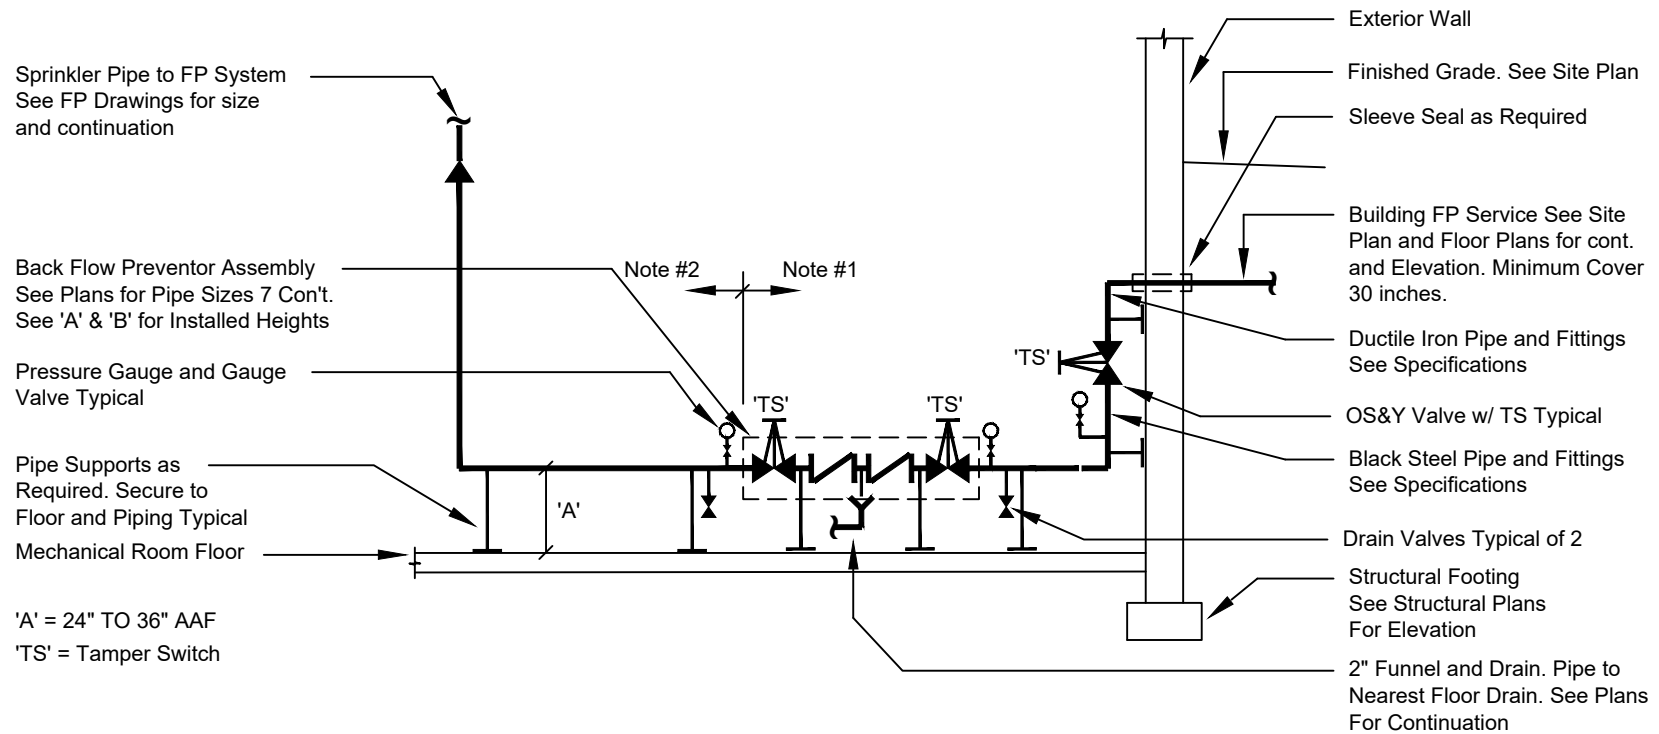

Below Grade Structure

Fire Protection Service Detail

No Scale

Note:

1. Back Flow Preventor, Pipe and Fittings Furnished and Installed by Plumbing Contractor. OS&Y Valves Furnished by Fire Protection Contractor and Installed by Plumbing Contractor. Tamper Switches Furnished and Installed by Fire Protection Contractor.
2. Sprinkler Pipe and Fittings Furnished and Installed by Fire Protection Contractor.
3. See Valve and Fitting Installation Details for Additional Requirements.